

Individual Incremental loading factor based maximum loadability limit prediction using modern optimization tools

DOI : 10.36909/jer.11507

S. Manohaaran* , K.Gnanambal**

*Dept of Electrical and Electronics Engineering. K.L.N College of Engineering, India,
sharpmano@gmail.com

**Dept of Electrical and Electronics Engineering. K.L.N.College of Engineering, India
gnans_balu@rediffmail.com

Abstract

Infrastructure innovation in the power system industry encourages more partakers to participate in the electricity market which improves the load utilization level. So, the maintenance of power system's agility with respect to any dynamic update in terms of load level is necessary. Precise prediction of maximum allowable loading point helps to enhance the power system agility and also improves the total allowable power transfer capability which in turn helps to supply continuous eminent power supply at the minimal cost to the customers by means of encouraging more contracts. Considering the above potential benefits, in this paper by using individual incremental loading factor (IILF) the precise prediction of total loadability limit (TLL) of the system is manipulated with the help of newly evolved meta-heuristic optimization algorithm such as Grey Wolf (GRW) optimizer and Flower Pollination Algorithm (FPA). The allowable single line contingency scenario is considering along with base case scenario to extract the more realistic TLL which helps to maintain the power system balance with respect to the dynamic nature of the load. The proposed maximum loading point extraction manipulation solution problem is tested with the help of three standard IEEE systems such as 30 Bus, 57 Bus and 118 bus systems. The extracted test results show that the predicted maximum allowable loading point enhances the load utilization level without affecting the system securities. The statistical performance measures of GRW and FPA confirmed the better balance of exploration and exploitation in extracting the optimal results.

Keywords: Individual Incremental Loading Factor (IILF), Total Loadability Limit (TLL), Grey Wolf (GRW) Optimizer, Flower Pollination Algorithm (FPA), Repeated Power Flow (RPF)

1. Introduction

The healthiness of any power system is to a large extent dependent on the balanced power supply with respect to any dynamic load utilization and with the restoration rate level in case of any contingency. So, the

essential roles of any power system operation and control is to pre-determine the maximum allowable demand at each existing load bus as well as in pre-categorizing the critical load buses and transmission lines in a power system. The function of determining maximum allowable demand of each load bus in a power system helps to extract the maximum allowable Total Loadability Limit (TLL) of a power system. TLL extraction process not only resolves the operation-based problems, but also provides constructive information for the distribution expansion planning, distributed generation sizing, tie-line capacity, FACTS device placements, etc., [1–5]. According to power system operational stance, the allowable TLL is the maximum load limit that a power system can serve the customers without violating any security constraints. Maximum loadability limit (MLL) based analysis is one of the best approach to appraise a power system in a steady state and also pre-determine the practical intellect of a security margin [6]. In the restructuring based deregulated electricity environments, power systems are often heavily traffic with high load utilization which may results in higher affinity toward instability. So, the prediction of MLL helps to provide reliable electric supply to the consumer without any contract violation and also at the optimal cost. Different mathematical models and optimization techniques, like classical, heuristic, and hybrid methods have been proposed to estimate MLL [7-11].

The progressive increase in the electric power demands until convergence methodology of conventional power flow has been followed at the initial stage in extracting the MLL [12]. In modern years, in order to find the appropriate MLL, OPF and Security Constrained Optimal Power Flow (SCOPF) based models have been widely used which plays an important role in power system operation, decision making, and market driven based problems [13-15]. OPF-based model has been presented in [16], as an extension of the power flow-based model in [17]. Even though finding the MLL using conventional power flow tools is well established problem but the conventional methodology needs lot of pre-analysis and also need lot of manual arbitration in knowing MLL [18,19]. Another complexity in the area of MLL research is that the enrichments to power flow-based approaches cannot be correctly applied which consider more practical network constraints [20]. Also, the usage of conventional optimization algorithm increases the mathematical stress and difficulty in handling the mixed data types such as integer, float and binary as a group control parameters.

The application of meta-heuristics based evolutionary optimization algorithm such as Genetic algorithm (GA), Particle Swarm Optimization algorithm (PSO) etc., provides the breakthrough for handling the mixed data types in all the complex power system problems. Due to its parameter handling capability with respect to any

number of dimensions, the optimal maximum loadability limit is determined using Hybrid PSO by considering the voltage limits as security constraints in each load buses. The voltage stability limit is the nose point of the PV curve after which the voltage collapse occurs. In the same paper, the load is uniformly incremented at all the load buses until bus voltages are violating [21]. In practical, the loadability level at each load bus will differ with respect to the congestion level of the bus. Hence, the dynamic incremental variation at all the load buses is necessary to predict the allowable MLL of any power system [24]. In literature [25], the Hybrid DEPSO algorithm was proposed to determine the maximum loading point by incrementing each load bus with variable loading factor under static condition. Due to the inherent nature of the power system such as overloading, transmission line disturbances and protection device failures, there is a high possibility of the contingency occurrence. Hence, the study of contingency based TLL extraction at each load buses is very much essential in the highly stressed power system to prevent any kind of uncertainties. Very Few literatures are available to determine the MLL of the power system by considering the contingency analysis. Analyzing the above difficulties, in this paper TLL of a power system is predicted by optimally extracting the individual incremental loading factor (IILF) for each load at the base case scenario and also at the single transmission line outages scenario. The Severity of the line contingency depends upon the least TLL differs from the base case scenario. In this proposed research work, newly evolved nature inspired highly balanced search based Grey Wolf (GRW) Optimizer algorithm [26 - 28] and Flower pollination algorithm (FPA) [29] are applied to extract the optimal loading factor of each load bus by satisfying the equality and inequality security constraints such as bus voltage limits, transmission line limits and power balance constraints with and without line outages. To test the effectiveness of the proposed approach and the robustness of the applied optimization algorithms, three different standard test systems such as IEEE 30, 57 and 118 are utilized and their test results are compared.

2. Individual Incremental Loading Factor (IILF) based problem formulation

Individual Incremental Loading Factor (IILF) method helps to predict the maximum load that can be added at each existing load bus. The pre-determination of each load demand helps to identify the stress level of the power system in the existing loading condition and also helps to improve the loadability utilizing level which in turn enhances the possibility of the economic contractual plan in any competitive electricity market. Therefore, the individual incremental loading factor method helps to determine the optimal allowable total loadability limit of the system which has been described in the following sections

2.1 Optimal mathematical Total Loadability Limit (TLL) objective Formulation at base case scenario

The main objective of the proposed problem is to extract the maximum secured Total Loadability Limit (TLL) in a power system via IILF determination at each load. To extract the proposed objective results, the following mathematical equation (1) has been modeled as follows

$$F_1 = \text{Max(TLL)} = \text{Max}\left(\sum_{i=1}^{\text{NLB}} (1 + \lambda_i) * P_{di}\right) \quad (1)$$

Where TLL= Total loadability limit of the system

λ_i = Individual Incremental loading factor at each load bus

NLB is the Number of Load Buses

Subject to

Constraints1: Power balance equations

$$P_{gi} - (P_{di} + \lambda_i) - \sum V_i V_j Y_{ij} \cos(\theta_{ij} + \delta_j - \delta_i) = 0 \quad (2)$$

$$(Q_{gi} - Q_{di}) - \sum V_i V_j Y_{ij} \sin(\theta_{ij} + \delta_j - \delta_i) = 0 \quad (3)$$

Constraints2: Voltage profile constraint

$$V_{imin} \leq V_i \leq V_{imax} \quad (4)$$

Constraints3: Real and reactive generation power constraints

$$P_{imin} \leq P_i \leq P_{imax} \quad (5)$$

$$Q_{imin} \leq Q_i \leq Q_{imax} \quad (6)$$

2.2 Optimal mathematical TLL objective formulation considering contingency scenario

Due to the sudden technical inconsistency such as overloading in load buses, power conversion device failure, unbalanced system faults etc., will impose high probability of transmission line outage from the power system. Therefore, there should be high concern in considering the transmission line outage while extracting the maximum loadability of the system. Highly sensitive transmission line outages are also possible i.e. the line outage which will not even allow increment a MW of the power demand in the base case system level. These highly sensitive transmission lines are not considered for extracting the maximum loadability. The inclusion of line outage in extracting the maximum loadability of the power system will newly define the objective function (7) as provided below

$$[F_2, \text{index}] = \text{Min}(\text{Max}(\text{TLL})) = \text{Min}_{0 \leq j \leq \text{NLO}} \{ \text{Max}(\sum_{i=1}^{\text{NLB}} (1 + \lambda_i) * P_{di}) \} \quad (7)$$

Where index is the line outage corresponding to min of max TLL which identifies the weakest line outage leads to no further additional loading

3. Optimization Algorithm Structure

The established positive efficiency of meta-heuristic Optimization such as Genetic Algorithm (GA), Particle Swarm Optimization (PSO), Differential Evolution (DE), FireFly algorithm (FFA) and Simulated Annealing (SA) in solving complex non-convex, multi-dimensional and multi variable power system increases the involvement of evolutionary, swarm based intelligence and nature inspired algorithms in obtaining various power system problem solutions in the last decade. The improved application of the meta-heuristics algorithm in modern power system engineering application paves the way for the evolution of many new nature inspired algorithm with quick search capability and with the better balance search technique. Grey Wolf (GRW) Optimizer and Flower pollination algorithm (FPA) are best among the recently evolved highly balanced search meta-heuristics algorithms.

3.1 Grey Wolf (GRW) Optimizer

Grey Wolf (GRW) Optimization is a newly evolved optimization framework inspired by Canadian grey wolves developed by Mirjalili [27]. The solutions of the GRW algorithm in non-convex engineering optimization problems proven to attain better search results compared to well established DE, PSO and GA based optimization methods. The search space flow process of the GRW algorithm is directed by three wolves, namely alpha (α), beta (β) and delta (δ). Alpha (α) is the leader of the grey wolves these may be a male or female, whereas the beta is the second level dominant grey wolves which advises the alpha in terms of process execution and also shares the instruction to the third level dominant delta wolves. All the process is implemented by omega (ω) wolves under the guidance of the delta wolves. So, the omega wolves' positions are ordered according to the three dominant grey wolves' positions. The three major phase of grey wolf hunting are tracking, encompassing and attacking the prey. These three dominant wolves will guide the omega wolves to identify the prey during hunting. Once the prey gets identified, the omega wolves will encircle and troublesome the prey until it stops moving. Based on the three phases of GRW hunting process, the solutions are designed in such a way that the global best fitness value are always extracted from the alpha (α) solutions consequently the second and third best fitness ones i.e. local best fitness values are extracted from the beta (β) and delta (δ) solutions. The above three alpha, beta and delta solutions helps to narrow the search space criteria in identifying the best solutions which provides the exploration concepts in search

methodology. Later, the solutions are exploited in the newly identified search space to extract better solutions. As mentioned above, the mathematical modeling of prey encircling behavior are proposed as follows

$$\vec{D} = |\vec{C} \cdot \vec{X}_p(t) - \vec{X}(t)| \quad (8)$$

$$\vec{X}(t + 1) = \vec{X}(t) - \vec{A} \cdot \vec{D} \quad (9)$$

Where t indicates the current iteration, \vec{A} and \vec{C} is coefficient vectors, \vec{X}_p is the position vector of the prey, and \vec{X} indicates the position vector of a grey wolf.

The vectors \vec{A} and \vec{C} are calculated as follows:

$$\vec{A} = 2\vec{a} \cdot \vec{r}_1 - \vec{a} \quad (10)$$

$$\vec{C} = 2 \cdot \vec{r}_2 \quad (11)$$

Where components of \vec{a} are linearly decreased from 2 to 0 over the course of iterations and r1, r2 are random vectors in the range of [0, 1]. The hunting knowledge of the three best wolves helps the omega wolves to identify the prey position. Based on the same, the mathematical model has been described as provided below

$$\vec{D}_\alpha = |\vec{C}_1 \cdot \vec{X}_\alpha - \vec{X}|, \vec{D}_\beta = |\vec{C}_2 \cdot \vec{X}_\beta - \vec{X}|, \vec{D}_\delta = |\vec{C}_3 \cdot \vec{X}_\delta - \vec{X}| \quad (12)$$

$$\vec{X}_1 = \vec{X}_\alpha - \vec{A}_1 \cdot (\vec{D}_\alpha), \vec{X}_2 = \vec{X}_\beta - \vec{A}_2 \cdot (\vec{D}_\beta), \vec{X}_3 = \vec{X}_\delta - \vec{A}_3 \cdot (\vec{D}_\delta) \quad (13)$$

Finally with the help of the top three grey wolves prey position knowledge, the new position vector is calculated by taking the average of the sum of three prey positions is given in the following equation

$$\vec{X}(t + 1) = \frac{\vec{X}_1 + \vec{X}_2 + \vec{X}_3}{3} \quad (14)$$

Grey wolves typically search with the positions of alpha, beta, and delta wolves. Basically, the three wolves diverge with each other in searching the prey and then converge to attack the prey. The divergence property of the GRW is accentuated with the help of vector component \vec{A} having the random value between -1 to 1 and with the help of \vec{C} vector contains random values in [0, 2] to search the solutions globally. The convergence property of the GRW is accelerated with the component \vec{a} by decrementing the value from 2 to 0. The above convergence and divergence characteristics assist GRW to show random behavior in search, favoring better balance in maintaining the premature avoidance and long convergence search avoidance. The GRW algorithm for the extraction of maximum TLL is described below

3.2 GRW algorithm

Step 1: Initialize the objective function F_1 mentioned in the section (2)

Step 2: Initialize the grey wolf position vector X (X_1, X_2, \dots, X_n) with the population size of 'NF x N'. Where 'NF' is the number of search agent grey wolves as 30 and 'N' is the number of individual incremental loading factor (IILF) pack size depends on the number of existing real power load connected in the test power system bus.

Step 3: Initialize the vector components $\vec{a}, \vec{A}, \vec{C}$ and maximum number of iteration ($ITER_{Max}$) which has been used in the GRW algorithm

Step 4: Calculate the fitness value using the objective function F_1 for the each position vector of grey wolf and identify the top three position vectors of prey. The first best (X_α) prey position vector, the second best (X_β) prey position vector and the third best (X_δ) prey position vector based on the fitness value.

Step 5: Using the top three prey position vector and with grey wolf position vector, update the positions of the top three best hunt wolves' position vectors such as X_1, X_2 and X_3 using the equations (12) and (13)

Step 6: Calculate the average of three position vector using the equation (14) and calculate its fitness value

Step 7: Compare the fitness value of current position vector of grey wolf with the newly created average position vector, if the fitness value is greater replace the current position vector for next iteration

Step 8: Repeat the step 4 to step 6 until the maximum iteration reaches

Step 9: Extract the optimal best IILF based on the fitness value of allowable TLL

Step 10: Repeat the step 1 to 9 by creating outage at all the transmission lines and extract the allowable TLL for each outage condition

Step 11: As discussed in the section (2.2), the minimized allowed TLL (F_2) with respect to the transmission line outage will be considered as the maximum allowable loadability of the system.

3.3 Flower Pollination Algorithm (FPA)

FPA based stochastic algorithm is exploited to resolve the optimization problem of extracting maximum allowable TLL with the optimal increment of IILF and also not violating the system security limits as given in the section 2.1. FPA is a nature inspired flower pollination behavior based optimization proposed by Xin-She Yang [29]. The core part of the FPA depends upon the two pollination methodology namely self-pollination and cross-pollination. Self-pollination is the process of one flower pollinates the same flower or other flowers of the same plant whereas the cross-pollination is the process of pollination between two different plants. Global pollination is

instigated by the biotic pollinating agents such as bees, bats, birds and flies. Biotic pollination agent follows the Levy distribution. Summarizing the following pollination characteristics as four regulations

1. Cross pollination act as a Global pollination and it is performing the Levy flights
2. Self-pollination is an abiotic local pollination act
3. Reproduction probability is assigned to flower constancy and is proportional to similarity of two flowers involved
4. The Probability has been tossed between 0 and 1 to control the cross pollination and self pollination. The pollination and reproduction of the fittest is given as below

$$v_i^{t+1} = v_i^t + L(v_i^t - d^*) \quad (15)$$

$$L \sim \frac{\mu \Gamma(\mu) \sin(\pi\mu/2)}{\pi} \frac{1}{s^{1+\mu}} \quad (s \gg s_0 > 0) \quad (16)$$

Where v_i^t is the pollen 'i' or solution vector v_i at iteration t, and d^* is the current best solution found among all solutions at the current generation/iteration. L is the strength of the pollination, which is a step size. Pollinators can move over a long distance with various distance steps, Levy flight distribution is used to mimic this characteristic efficiently. $\Gamma(\mu)$ is the standard gamma function, and this distribution is valid for large steps $s > 0$. The local pollination and flower constancy can be represented as

$$v_i^{t+1} = v_i^t + \varepsilon(v_j^t - v_k^t) \quad (17)$$

Where v_j^t and v_k^t are pollens from the different flowers of the same plant species. This essentially mimics the flower constancy in a limited neighborhood. Mathematically, if v_j^t and v_k^t comes from the same species or selected from the same population, this become a local random walk if we draw 'ε' from a uniform distribution in [0, 1]. The FPA algorithm structure for the extraction of maximum TLL is described below

Step 1: Initialize objective function f1 as mentioned in the section (2.1)

Step 2: Initialize a flower pollen population of X (X_1, X_2, \dots, X_n) with the population size of 'NF x N'. Where 'NF' is the number of flowers as 30 and 'N' is the number of IILF based on the existing load point in a power system.

Step 3: Extract the maximum fitness value in the initial population

Step 4: Initialize the switch probability p between [0, 1]

While (t < Maximum Iteration)

For $i = 1$: NF

 If random value $< p$,

 Cross pollination has been processed via equation (15) via equation (16)

 Else

 Generate the ϵ from a uniform distribution in $[0, 1]$

 Arbitrarily select the j^{th} and k^{th} flower among all the solutions

 Do self-pollination via equation (17)

 End if

Step 5: Determine the new fitness value for the extracted flower pollen population size

Step 6: If new fitness values is better than existing population fitness value, update them in the population

 End for

Step 7: Locate the best solution in the current population based on the objective fitness value (F_1)

 End while

Step 8: Repeat the step 1 to 7 by creating outage at all the transmission lines and extract the allowable TLL for each outage condition

Step 9: As discussed in the section(2.2), the minimized allowed TLL (F_2) with respect to the transmission line outage will be considered as the maximum allowable loadability of the system.

4. Results and Discussions

The Proposed Maximum Allowable Total loadability limit (TLL) extraction methodology discussed in sections (2.2) and (2.3) has been tested using the three standard test systems such as IEEE 30, IEEE 57 and IEEE 118 buses. Newly evolved nature based inspired meta-heuristic algorithms such as Grey Wolf (GRW) optimizer and Flower pollination algorithm (FPA) are applied to extract the better solutions as discussed in the sections (3.2) and (3.3) using the MATLAB R2014a programming language. The brief structured data of the three test system with the base case real power and reactive load demands, the evaluated line loss with the critical voltage and its bus using the Standard Newton's Power Flow methodology are tabulated in the table -1. The control parameters applied in the GRW and FPA are provided in the table -2.

Table – 1 Base Case parameter of Implemented IEEE Test Systems

Parameter	IEEE 30 Bus	IEEE 57 Bus	IEEE 118 Bus
-----------	-------------	-------------	--------------

Total No of Existing Load connected Bus	20	40	99
Total No of Generator Bus	6	7	54
Total Transmission Line	41	80	184
Existing Total Real power demand in Per unit ($\sum P_{Di}$)	1.892	12.25	42.42
Existing Total Reactive power demand in Per unit ($\sum Q_{Di}$)	1.072	3.364	14.38
Total Real power line loss in Per unit ($\sum P_{Li}$)	0.0244	0.2786	1.32863
Total Reactive power line loss in Per unit ($\sum P_{Di}$)	0.0899	1.2167	7.8379
Critical Voltage Magnitude in Per unit	0.961	0.936	0.943
Critical Voltage Bus	8	31	76
Minimum Voltage Magnitude in Per unit	0.95	0.93	0.94
Maximum Voltage Magnitude in Per unit	1.05	1.06	1.06

Table – 2 Applied Optimization Algorithm’s Control Parameters

Algorithm Control Parameters	FPA
Flower population Size	30
Step Size	2.5
Gamma function parameter (μ)	1.5
Termination	500
	GRW
Wolves population Size	30
Termination	500
Vectors $\vec{r}1$ and $\vec{r}2$	Random value between 0 and 1
\vec{a} component	Linearly decreased from 2 to 0

The implemented test results are detailed in the below sections as follow

4.1. Maximum allowable TLL extraction in Base case scenario

GRW and FPA based determination of Maximum allowable TLL by extracting the Optimal incremental loading

Bus	GRW	FPA	GRW	FPA	Bus	GRW	FPA	GRW	FPA
------------	------------	------------	------------	------------	------------	------------	------------	------------	------------

factor in each load bus without affecting the system’s security constraints are tested in the IEEE 30, 57,118 bus systems and its newly predicted real power demand for each loaded bus at the base case scenario with its individual incremental loading factor (IILF) are updated in the tables 3, 4 and 5 respectively.

Table – 3 Optimal Base case IILF and real power demand of each load in IEEE 30 Bus system

	Total Real power load in p.u		IILF Factor(λ)			Total Real power load in p.u		IILF Factor(λ)	
2	0.433282	0.433977	0.9967	0.9999	17	0.092173	0.101521	0.0241	0.128
3	0.047977	0.038546	0.999	0.6061	18	0.041532	0.039762	0.2979	0.2426
4	0.15184	0.150864	0.9979	0.9851	19	0.107982	0.112253	0.1367	0.1816
7	0.433293	0.450904	0.9004	0.9776	20	0.027608	0.026363	0.2549	0.1983
8	0.300562	0.300748	0.0019	0.0025	21	0.306348	0.215256	0.7506	0.23
10	0.059645	0.069808	0.0284	0.2036	23	0.061536	0.060661	0.923	0.8957
12	0.196697	0.195712	0.7562	0.7474	24	0.158948	0.170408	0.827	0.9587
14	0.114549	0.093991	0.8476	0.516	26	0.041072	0.044636	0.1735	0.2753
15	0.088757	0.124373	0.0824	0.5167	29	0.028308	0.030417	0.1795	0.2674
16	0.036596	0.061004	0.0456	0.743	30	0.138717	0.139522	0.3087	0.3162

Table – 4 Optimal Base case IILF and real power demand of each load in IEEE 57 Bus system

Bus Number	GRW	FPA	GRW	FPA	Bus Number	GRW	FPA	GRW	FPA
	Total Real power load in p.u		IILF Factor (λ)			Total Real power load in p.u		IILF Factor(λ)	
1	1.099695	1.088195	0.9994	0.9785	29	0.176587	0.177955	0.0387	0.0468
2	0.03842	0.036154	0.2807	0.2051	30	0.036032	0.036048	0.0009	0.0013
3	0.819388	0.807246	0.9985	0.9689	31	0.058052	0.058106	0.0009	0.0018
5	0.229115	0.236032	0.7624	0.8156	32	0.016029	0.016004	0.0018	0.0002
6	0.795567	0.803429	0.0608	0.0712	33	0.038036	0.038002	0.0009	0.0001
8	2.020999	2.043847	0.3473	0.3626	35	0.060098	0.060301	0.0016	0.005
9	1.217109	1.250144	0.0059	0.0332	38	0.140947	0.140547	0.0068	0.0039
10	0.056656	0.05617	0.1331	0.1234	41	0.064041	0.064572	0.0165	0.025
12	5.343294	5.0613	0.4173	0.3425	42	0.071912	0.071672	0.0128	0.0095
13	0.182735	0.186999	0.0152	0.0389	43	0.022612	0.023941	0.1306	0.197
14	0.110993	0.119924	0.0571	0.1421	44	0.120902	0.121518	0.0075	0.0127
15	0.225738	0.231918	0.0261	0.0542	47	0.299585	0.302832	0.0087	0.0196
16	0.856814	0.819954	0.9926	0.9069	49	0.183338	0.182763	0.0185	0.0153
17	0.838349	0.83406	0.9961	0.9859	50	0.213503	0.215846	0.0167	0.0278
18	0.278469	0.279994	0.0238	0.0294	51	0.259828	0.285577	0.4435	0.5865
19	0.033551	0.034374	0.0167	0.0416	52	0.055542	0.054041	0.1335	0.1029
20	0.023308	0.023602	0.0134	0.0262	53	0.206608	0.210145	0.033	0.0507
23	0.063444	0.063721	0.007	0.0114	54	0.049018	0.046072	0.1956	0.1237
25	0.06309	0.063172	0.0014	0.0027	55	0.07287	0.094907	0.0716	0.3957
27	0.093167	0.093556	0.0018	0.006	56	0.076169	0.077011	0.0022	0.0133
28	0.0466	0.046787	0.013	0.0171	57	0.067933	0.068345	0.0139	0.0201

Table – 5 Optimal Base case IILF and real power demand of each load in IEEE 118 Bus system

Bus	GRW	FPA	GRW	FPA	Bus	GRW	FPA	GRW	FPA
-----	-----	-----	-----	-----	-----	-----	-----	-----	-----

Number	Total Real power load in p.u		IILF Factor(λ)		Number	Total Real power load in p.u		IILF Factor(λ)	
1	0.821904	0.80006	0.6116	0.5687	59	5.534329	5.538662	0.998	0.9995
2	0.293678	0.291941	0.4684	0.4597	60	1.503009	1.55064	0.9269	0.988
3	0.482425	0.503857	0.237	0.2919	62	1.508317	1.532296	0.9589	0.99
4	0.427469	0.418715	0.0961	0.0736	66	0.773426	0.777897	0.9831	0.9946
6	0.683728	0.681984	0.3149	0.3115	67	0.513867	0.514672	0.8352	0.8381
7	0.253922	0.253265	0.3364	0.333	70	1.138176	1.137176	0.7245	0.723
8	0.493001	0.458246	0.7607	0.6366	72	0.143314	0.14171	0.1943	0.1809
11	0.753219	0.759095	0.076	0.0844	73	0.068122	0.066885	0.1354	0.1148
12	0.550342	0.545269	0.1709	0.1601	74	0.928876	0.928103	0.366	0.3649
13	0.54755	0.546472	0.6104	0.6073	75	0.483609	0.475694	0.029	0.0121
14	0.180065	0.178024	0.2862	0.2716	76	0.724669	0.704692	0.0657	0.0363
15	1.065323	1.064572	0.1837	0.1829	77	1.035391	1.030705	0.6974	0.6897
16	0.265704	0.266758	0.0628	0.067	78	1.149132	1.145119	0.6185	0.6128
17	0.125971	0.122291	0.1452	0.1117	79	0.69983	0.68824	0.7944	0.7647
18	0.692428	0.708218	0.154	0.1804	80	2.425935	2.556005	0.8661	0.9662
19	0.725789	0.696901	0.6129	0.5487	82	0.785303	0.798818	0.4543	0.4793
20	0.268527	0.263733	0.4918	0.4652	83	0.204848	0.216375	0.0242	0.0819
21	0.160424	0.156712	0.1459	0.1194	84	0.185019	0.184694	0.682	0.679
22	0.134895	0.130368	0.3489	0.3037	85	0.35647	0.332518	0.4853	0.3855
23	0.071152	0.072392	0.0165	0.0342	86	0.395239	0.377004	0.8821	0.7953
24	0.216468	0.215608	0.6651	0.6585	88	0.608279	0.627124	0.2672	0.3065
27	0.819682	0.808425	0.1545	0.1386	90	2.276467	2.219436	0.3966	0.3616
28	0.252992	0.255721	0.4882	0.5042	91	0.118063	0.118913	0.1806	0.1891
29	0.339799	0.335735	0.4158	0.3989	92	1.165975	1.139526	0.7938	0.7531
31	0.435797	0.43955	0.0135	0.0222	93	0.214998	0.220307	0.7917	0.8359
32	0.638462	0.635879	0.0821	0.0778	94	0.499032	0.497875	0.6634	0.6596
33	0.273483	0.269623	0.1891	0.1723	95	0.650441	0.68437	0.5487	0.6295
34	0.64692	0.653036	0.0965	0.1068	96	0.423682	0.41655	0.115	0.0962
35	0.396695	0.391181	0.2021	0.1854	97	0.196286	0.195583	0.3086	0.3039
36	0.403586	0.419105	0.3019	0.352	98	0.446257	0.45083	0.3125	0.326
39	0.519448	0.50558	0.9239	0.8725	99	0.602975	0.598288	0.4357	0.4245
40	1.139372	1.173934	0.7263	0.7787	100	0.462554	0.472405	0.2501	0.2768
41	0.713564	0.729947	0.9286	0.9728	101	0.252062	0.245284	0.1457	0.1149
42	1.303333	1.323012	0.3576	0.3781	102	0.074542	0.076717	0.4908	0.5343
43	0.218329	0.222343	0.2129	0.2352	103	0.277003	0.277419	0.2044	0.2062
44	0.177175	0.170152	0.1073	0.0634	104	0.618434	0.584841	0.6275	0.5391
45	0.988033	1.058952	0.8642	0.998	105	0.480056	0.497041	0.5486	0.6034
46	0.555694	0.551585	0.9846	0.9699	106	0.509245	0.501277	0.1843	0.1658
47	0.595614	0.586843	0.7518	0.726	107	0.786805	0.76989	0.5736	0.5398
48	0.290236	0.295842	0.4512	0.4792	108	0.022528	0.022647	0.1264	0.1324
49	1.718026	1.734802	0.9747	0.994	109	0.122198	0.124062	0.5275	0.5508
50	0.215207	0.219273	0.2659	0.2898	110	0.484102	0.49351	0.2413	0.2654
51	0.251715	0.245866	0.4807	0.4463	112	0.719564	0.737387	0.0582	0.0844
52	0.205871	0.208209	0.1437	0.1567	113	0.065533	0.062551	0.0922	0.0425
53	0.23734	0.236013	0.0319	0.0261	114	0.114601	0.114173	0.4325	0.4272
54	2.227206	2.258996	0.971	0.9991	115	0.304804	0.29891	0.3855	0.3587
55	1.217879	1.228732	0.9331	0.9504	116	3.673752	3.67823	0.9966	0.999
56	1.628714	1.673129	0.9389	0.9918	117	0.229224	0.225434	0.1461	0.1272
57	0.148261	0.144672	0.2355	0.2056	118	0.336364	0.33326	0.0193	0.0099
58	0.130577	0.136889	0.0881	0.1407					

It is inferred from the table-3; table- 4 and table-5 that the FPA and GRW based optimal IILF are more or less equal with slight variation which helps to confirm the correctness of the applied algorithmic solutions with respect to any number of search parameter variations. To check the effectiveness of the proposed IILF based maximum loading point determination, the system’s maximum loading capacity extracted from the optimal variable IILF based method using FPA and GRW are compared with the optimal constant incremental loading factor based methods via PSO, HPSO, MAPSO, MAHPSO, DE, DEPSO and its results are tabulated in the table-6.

Table – 6 Comparison of Maximum allowable TLL of the Test Systems

Algorithms	Maximum Total loadability limit of the Test System in p.u			Percentage Increase of Maximum Demand from the existing loadability condition		
	IEEE 30 Bus System	IEEE 57 Bus System	IEEE 118 Bus System	IEEE 30 Bus system	IEEE 57 Bus System	IEEE 118 Bus system
PSO	2.6010	14.039	56.443	37.4736	12.312	33.057
HPSO	2.6035	14.062	56.445	37.6057	12.496	33.062
MAPSO	2.6080	NA	56.449	37.8488	NA	33.071
MAHPSO	2.6081	NA	56.45	37.8478	NA	33.074
DE	2.6709	NA	56.6212	41.1681	NA	33.477
DEPSO	2.6974	NA	57.016	42.5687	NA	34.408
FPA	2.8607	16.52	65.19	49.9471	32.16	53.677
GRWO	2.8674	16.72	65.43	51.3742	33.76	54.240
RPF	2.6	14.2	56.4	38.02	15.92	32.96

The comparison results will be the evidence for the enhancement of system loadability limit to the great extent from the base case condition in variable loading demand based TLL extraction. The above evidence is illustrated with the help of comparison based on the percentage increase of maximum loadability from the existing loading condition of the system.

The convergence result graph of the GRW and FPA has depicted in the Figures from 1 to 3 for the IEEE 30, 57 and 118 bus systems respectively.

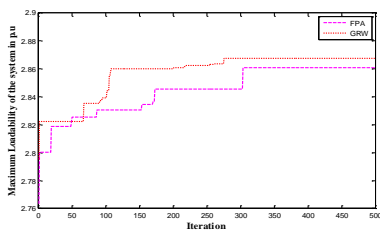


Fig.1 Base case convergence graph of IEEE 30 Bus test system

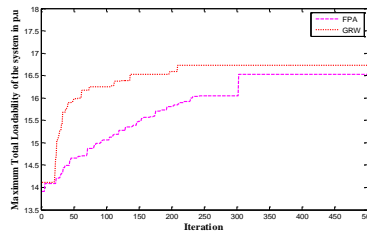


Fig.2 Base case convergence graph of IEEE 57 Bus test system

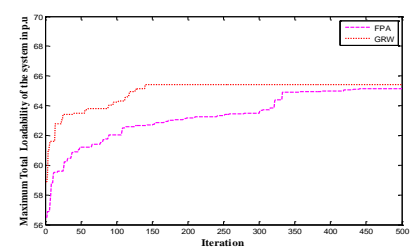


Fig.3 Base case convergence graph of IEEE 118 Bus test system

The inference of the convergence graph shows that the GRW has better solution and also better balance in the exploration and exploitation search than FPA while extracting the maximum loadability of the system with respect to the number of IILF variations based on the structure of the power system. The voltage profile of the IEEE 30, 57 and 118 bus systems at the FPA and GRW based optimal loading point condition are depicted in the figure 4, 5 and 6 respectively. It is inferred from the voltage profile that the extraction of the maximum loading point is done at the critical margin of the system voltage level without violating the system voltage limits.

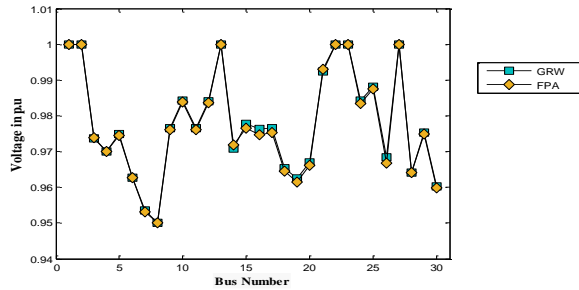


Fig.4. Optimal loadability based Voltage graph in IEEE 30 Bus test system

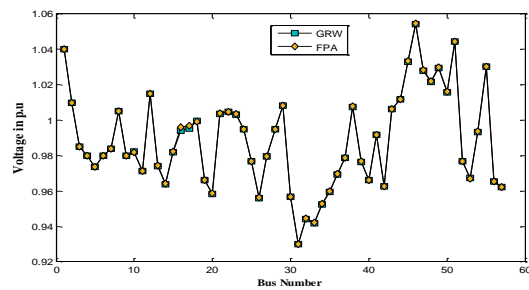


Fig.5. Optimal loadability based Voltage graph in IEEE 57 Bus test system

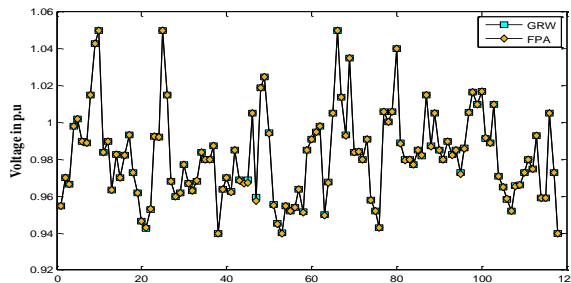


Fig.6. Optimal loadability based Voltage graph in IEEE 118 Bus test system

Statistical measures such as mean, best, worst, standard deviation and convergence iteration helps to evaluate the performance of the optimization algorithm. The performance of GRW and FPA based optimization of maximum loading point extraction are evaluated by conducting 20 different trails and its parametric measures are updated in the table – 7. The inference of the performance table clearly indicates that both the FPA and GRW are exceptionally good in extracting the best objective solutions but in terms of standard deviation GRW helps to provide better search solution with respect to any number of iteration and also the convergence rate is better compared to the FPA.

Table – 7 Statistical measures of GRW and FPA

Test System	Algorithm	Worst	Mean	Best	Standard Deviation	No of Iteration for convergence
30 Bus	FPA	2.8351	2.845	2.860	0.0083	320
	GRW	2.8521	2.859	2.867	0.0043	125
57 Bus	FPA	15.286	15.672	16.52	0.2279	280
	GRW	16.584	16.669	16.72	0.0508	300
118 Bus	FPA	63.578	64.137	65.19	0.4885	210
	GRW	64.526	64.964	65.43	0.3302	220

4.2 Maximum allowable TLL extraction in line contingency scenario

Total loadability limits (TLL) for all the allowable single line outages from the transmission line are manipulated using FPA and GRW based optimization algorithm. Based on the severity of the line contingency, the TLL will be decreased from the base case value. So, the manipulated results are sorted in descending order and the top five ranking line outages along with base case scenario were taken out. The extracted results are tabulated in the table – 8 for all the three test system.

Table – 8 Allowable Contingency Severity ranking of different bus systems

Allowable Contingency Severity ranking	Severe Line Outage	FPA TLL in Per unit	GRW TLL In Per Unit
IEEE 30 Bus System			
1	5 - 7	2.1254	2.1694
2	2 - 6	2.1492	2.1881
3	2 - 5	2.275	2.2782
4	2 - 4	2.4456	2.4587
5	1 - 3	2.4692	2.4835
	Base Case	2.8607	2.8674
IEEE 57 Bus System			
1	12 - 13	14.1328	14.2568
2	12- 16	14.3645	14.3758
3	23 - 24	16.0953	16.118
4	11 - 43	16.2051	16.2107
5	7 - 8	16.2937	16.3921
	Base Case	16.5267	16.7261
IEEE 118 Bus System			
1	69-70	57.1418	58.0465
2	69 - 77	59.8238	60.2258
3	26 - 30	60.0502	60.3762
4	64 - 65	60.9535	61.1771
5	30 - 38	61.2438	61.5451
	Base Case	65.1957	65.42925

Both the FPA and GRW help to provide the same ranking results in terms of line outage. The transmission line outage from bus 5 and bus 7, the line outage from the bus 12 and bus 13, the line outage from the bus 69 and bus 70 will be considered as the allowable severe line contingencies for the IEEE 30, 57 and 118 bus systems respectively. The GRW TLL results of severe line outages are better compared to FPA and also the GRW based results shows better convergence and searching balance which is evident from the convergence graphs. These graphs are given in figure 7, 8 and 9 for the 30, 57 and 118 bus systems respectively. So, the GRW based minimized severe line outage TLL are predicted as the Maximum allowable total loadability limit of the system.

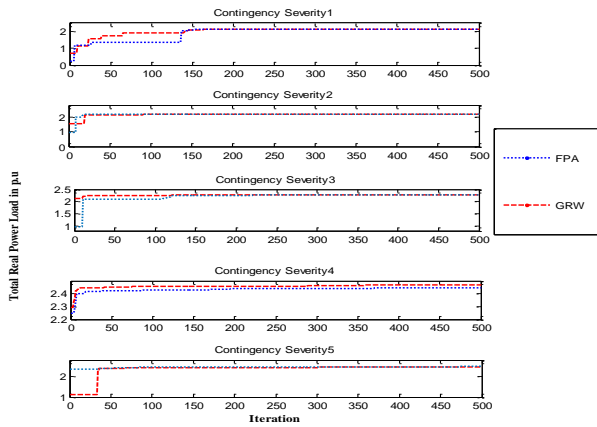


Fig.7 Contingency Cases convergence graph of IEEE 57 Bus IEEE 30 Bus Test system

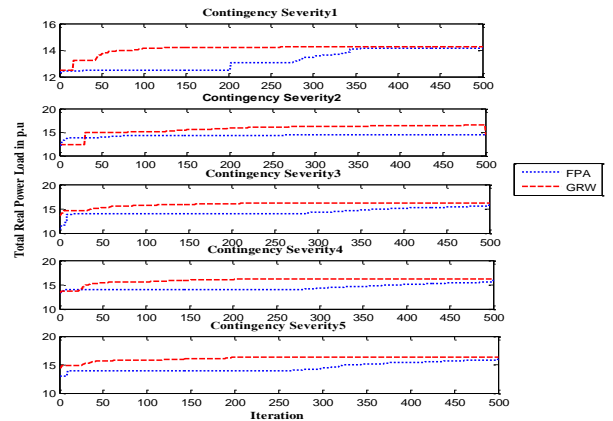


Fig.8 Contingency Cases convergence graph of Test system

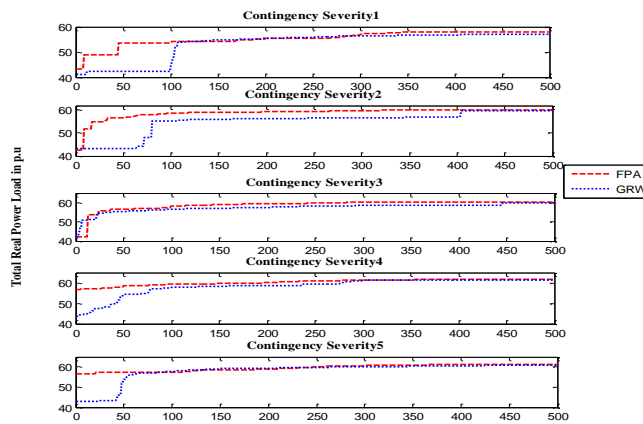


Fig.9 Contingency Cases convergence graph of IEEE 118 Bus Test system

Conclusion

The proposed approach of predicting maximum allowable total loadability limit through optimal determination of IILF helps to augment the load utilization level which in turn improves the agility of the power system in

sustaining system's power balance with respect to any additional load inclusion and also at any unbalanced scenarios. The forecasting of allowable incremental loading capacity in each loading point helps the producer or power supplier to choose the better bus position for the injection of power supply and also helps the customer to extract the load from the better load bus. Since both the producers and consumers are benefited, the proposed approach paves the path for achieving the socio-economic benefits. The statistical results of the optimization algorithm confirms that the application of modern meta-heuristics optimization such as GRW and FPA helps to extract better solutions by maintaining the balanced intensification and diversification search process with respect to any number of search parameter variations.

References

- M.R. Mansour, L.F.C. Alberto, R.A. Ramos, Preventive control design for voltage stability considering multiple critical contingencies, *IEEE Trans. Power Syst.*31 (March (2)) (2016) 1517–1525.
- P. Prakash, D.K. Khatod, Optimal sizing and siting techniques for distributed generation in distribution systems: a review, *Renew. Sustain. Energy Rev.* 57(2016) 111–130.
- L. Rocha, R. Castro, J.M.F. de Jesus, An improved particle swarm optimization algorithm for optimal placement and sizing of STATCOM, *Int. Trans. Electr.Energy Syst.* 26 (4) (2016) 825–840.
- M. Saravanan, S.M.R. Slochanal, P. Venkatesh, J.P.S. Abraham, Application of particle swarm optimization technique for optimal location of FACTS devices considering cost of installation and system loadability, *Electr. Power Syst. Res.*77 (3–4) (2007) 276–283.
- Y.-C. Chang, Multi-objective optimal thyristor controlled series compensator installation strategy for transmission system loadability enhancement, *Gener.Transm. Distrib. IET* 8 (March (3)) (2014) 552–562.
- P. Acharjee, Identification of maximum loadability limit and weak buses using security constraint genetic algorithm, *Int. J. Electr. Power Energy Syst.* 36 (1)(2012) 40–50.
- S.D. Naik, M.K. Khedkar, S.S. Bhat, Effect of line contingency on static voltage stability and maximum loadability in large multi bus power system, *Int. J.Electr. Power Energy Syst.* 67 (2015) 448–452.
- A.J. Conejo, L.B. Morales, S.J. Kazempour, A.S. Siddiqui, *Investment in Electricity Generation and Transmission*, Springer International Publishing,2016.

- Amgad, A EL-Dib., Hosam, K.M Youssef., EL-Metwally, M.M., Osrnan, Z.: Maximum loadability of power systems using hybrid particle swarm optimization. *Electr Power Syst Res* ,76:485–92,(2006)
- N. Alguacil, A.L. Motto, A.J. Conejo, Transmission expansion planning: a mixed-integer LP approach, *IEEE Trans. Power Syst.* 18 (August (3)) (2003)1070–1077.
- Z. Hu, X. Wang, Efficient computation of maximum loading point by load flow method with optimal multiplier, *Power Syst. IEEE Trans.* 23 (May (2)) (2008)804–806.
- A. Kazemi, B. Badrzadeh, Modeling and simulation of SVC and TCSC to study their limits on maximum loadability point, *Int. J. Electr. Power Energy Syst.* 26(8) (2004) 619–626.
- C. Gómez-Quiles, A. Gómez-Expósito, W. Vargas, Computation of maximum loading points via the factored load flow, *IEEE Trans. Power Syst.* 31 (5) (2016)4128–4134.
- G. Yang, G. Hovland, R. Majumder, Z. Dong, TCSC allocation based on line flow based equations via mixed-integer programming, *Power and Energy Society General Meeting—Conversion and Delivery of Electrical Energy in the 21st Century*, 2008 IEEE (2008), p. 1.
- M. Pourakbari-Kasmaei, M.J. Rider, J.R.S. Mantovani, An unequivocal normalization-based paradigm to solve dynamic economic and emission active-reactive OPF (optimal power flow), *Energy* 73 (2014) 554–566.
- F. Milano, C.A. Canizares, M. Invernizzi, Multi objective optimization for pricing system security in electricity markets, *Power Syst. IEEE Trans.* 18 (May(2)) (2003) 596–604.
- A.L. Ara, A. Kazemi, S.A.N. Niaki, Multi objective optimal location of FACTS shunt-series controllers for power system operation planning, *IEEE Trans. PowerDeliv.* 27 (April (2)) (2012) 481–490.
- S. Binato, M.V.F. Pereira, S. Granville, A new Benders decomposition approach to solve power transmission network design problems, *IEEE Trans. Power Syst.* 16 (May (2)) (2001) 235–240.
- G.D. Irisarri, X. Wang, J. Tong, S. Mokhtari, Maximum loadability of power systems using interior point nonlinear optimization method, *Power Syst. IEEE Trans.* 12 (February (1)) (1997) 162–172.
- I. El-Samahy, K. Bhattacharya, C. Canizares, M.F. Anjos, J. Pan, A procurement market model for reactive power services considering system security, *IEEE Trans. Power Syst.* 23 (February (1)) (2008) 137–149.
- A.A. EL-Dib, H.K.M. Youssef, M.M. EL-Metwally, Z. Osman, Maximum loadability of power systems using hybrid particle swarm optimization, *Electr. Power Syst. Res.* 76 (6–7) (2006) 485–492.

M.M.A. Abdelaziz, E.F. El-Saadany, Maximum loadability consideration in droop-controlled islanded micro grids optimal power flow, *Electr. Power Syst.Res.* 106 (2014) 168–179.

T. Van Cutsem, Voltage instability: phenomena, countermeasures, and analysis methods, *Proc. IEEE* 88 (February (2)) (2000) 208–227.

Shunmugalatha, A., Mary Raja Slochanal, S.: Maximum loadability of a power system using multi agent-based hybrid particle swarm optimization. *Electr Power Compon Syst*,36:575–86, (2008)

Gnanambal, K., Babulal, C.K.: Maximum loadability limit of power system using hybrid differential evolution with particle swarm optimization. *Electrical Power and Energy Systems* 43 ,150–155, (2012)

SyedaliMirjalili, Seyed Mohammad Mirjalili, Andrew Lewis: Grey Wolf Optimizer. *Advances in Engineering Software* 69 (2014) 46–61

Mech LD. Alpha status, dominance, and division of labor in wolf packs. *Can J Zool* 1999;77:1196–203.

Muro C, Escobedo R, Spector L, Coppinger R. Wolf-pack (*Canis lupus*) hunting strategies emerge from simple rules in computational simulations. *Behav Process* 2011;88:192–7.

Xin-She Yang, Flower pollination algorithm for global optimization, in: *Unconventional Computation and Natural Computation 2012*, Lecture Notes in Computer Science, Vol. 7445, pp. 240-249 (2012).